





Generating Set Base Frame - Diesel

GE.DW.580/520.BF+011

1500 rpm - Trifase - 50Hz - 400V Automatic panel without switching on board



Image for demonstration purposes

Standard equipment

Exhaust

Exhaust manifold protection Silenced muffler -15dB(A)

Fuel Supply

Single wall daily tank with bunded base Automatic shutdown system for low fuel level Fuel gauge

A Handling

n.4 lifting hooks integrated into the bearing structure

Base Frame

Bunded base at 110% of fuel tank capacity Anti-vibrating mounting pads

Engine

Engine pre-heater 230V

High coolant temperature and low oil pressure shutdown

Oil pressure and coolant temperature gauge (only with QPE or +14 variant)

External oil drain points

Engine liquids (oil and antifreeze)

Rotating parts protection

Electronic speed governor

Radiator level sensor

Alternator

AVR Automatic Voltage Regulator AVR Pre-arranged for parallel Impregnation for marine environment

Panel & connection

Emergency Stop button Magnetothermal circuit breaker on alternator board Cable output from side IP44 wiring Start-up battery (pre-charged) Grounding point

Documentation

CE conformity declaration User and Maintenance manual Wirings diagrams

Normatives 1

All Generating sets are compliant to CE Marking 2014/30/UE Electromagnetic compatibility 2000/14/CE Noise Emission for outdoor use Factory-designed systems built according to ISO 9001:2015 CEI EN 60204-1:2018 - Electrical equipment of machines















Primary data

General Information


Speed	RPM 1	500
Frequency	Hz 5	50
PRP	KVA 5	330
PRP - Prime power	KW 4	224
LTP - Standby power	KVA 5	80
LTP - Standby power	KW 4	64
Standard Voltage	V 4	00/230
Current	A 7	65,9
Voltage for current calculation	V 4	000
	0,8	0,8
General electrical protection	0,0	
	0,0	
General electrical protection Rated current	A 8	300
General electrical protection	A 8	
General electrical protection Rated current Type Poles Fuel Consumption	A 8 N N 4	000 Magnetothermal switch on the alternator board
General electrical protection Rated current Type Poles Fuel Consumption TYPE	A 8 N 4	Diesel
General electrical protection Rated current Type Poles Fuel Consumption TYPE Standard Fuel Tank capacity	A 8 N N 4	Agnetothermal switch on the alternator board P Diesel
General electrical protection Rated current Type Poles Fuel Consumption TYPE	A 8 N 4	Agnetothermal switch on the alternator board P Diesel
General electrical protection Rated current Type Poles Fuel Consumption TYPE Standard Fuel Tank capacity	A 8 N N 4 It 4 h 5	Diesel
General electrical protection Rated current Type Poles Fuel Consumption TYPE Standard Fuel Tank capacity Autonomy @ 75% load	A 8 N N 4 L L L L L L L L L L L L L L L L	Diesel

General data

Rated capacity	Ah	2x180
Auxiliary Voltage	V	24
Exhaust gas temperature	°C	536
Exhaust gas flow	I/s	1500
Combustion air flow	I/s	513
Cooling fan airflow	mc/s	11,6

Weight and Dimensions

Dimensions (L x W x H)	cm	350x150x190
Weight with liquids (excluding optionals and fuel)	Kg (+/-3%)	3844







Factory		Doosan
Model		DP158 LDF
Emissions stage		Stage 0
Speed governor		Electronic
Radiator	℃	43
Cooling	Tipo	liquid (water + 50% Paraflu11)
Active net power	Kwm	448
Nominal net power	CV	608,7
Cycle	Tipo	4 strokes
Injection	Tipo	Direct
Aspiration	Tipo	Turbo
Numbers of cylinders	N	8
Cylinders arrangement		V
Bore	mm	128
Stroke	mm	142
Total displacement	lt	14,611
Engine oil features		15W40-API CI-4/CH-4 ACEA E5-E7
Total oil capacity	lt	22
Total coolant capacity	lt	79
ISO 8528-5 class		G2

The emission levels of the exhaust gas are indicated in the engine technical datasheet. Any changes due to more restrictive regulatory adjustments are excluded.

Alternator

* May vary based on stock availability. However, a primary brand will be used.

Factory		Stamford
Model		S5L1D-D
PRP continuous power	KVA	550
Voltage Regulator (voltage accuracy)	+/- %	1
Poles	N°	4
Phases	N°	3+N
Standard windings connection		Star Series
Stator/rotor impregnation		H (Outdoor Temp 40°C)
Efficiency	%	94,3
Engine coupling		Elastic disk
Short circuit current		>= 300% (3In)
Protection degree	IP	23
Cooling system		Self ventilating
Maxium overspeed	rpm	2250
Waveform distortion	%	<5
Exciter		Diode bridge

Standard operating environmental conditions


Ambient temperature	°C	25
Relative Humidity	%	30
Max altitude	mt	1000





Control Systems on board QPE-C-SC-3F-V1





The QPE-C control panel represents the evolution of the panel for the control and management of the gen set. With its microprocessor logic it is able to meet any user requested features. The dual operation mode manual and automatic guarantees to every type of functionality protection, analysis and control of the generating set in order to make the management easy and efficient. Variant without transfer switch on board. ATS panel type QC as optional. The panel manages the QC panels directly or any other ATS panel.

Mechanical features

Protection degree	IP	55
Totection degree	11	33

Battery charger

Model		ELCOS - CB1	
Maximum output current	Α	2,5	
Output DC voltage (selectable)	Vdc	12-24	
Input AC voltage (selectable)	Vac	220-260	
Frequency	Hz	50-60	

Data Communication

Data connection port	RS-485
Communication protocol	Mod-bus RTU-8N1

Remotable functions in terminal box

GS start
Genset contactor close/open command (1)
Common Alarm - DC output
GS start with key in OFF position (Only in MRS mode)

GS lock
Mains contactor close/open command (2)
GS test without load
Programmable output - Volt free output





Model MC4 Operating mode AMF - MRS

Specifics

Applications

Emergency to the Mains Stand-alone Construction site/Rental Self-production

ENGINE MEASURES

Fuel tank level % Engine oil pressure BAR (1)

Engine Coolant temperature °C (1)
Total run time

Partial run time Hours to maintenance Battery voltage

Battery charging voltage

Start-ups counter Engine speed (2)

Engine Oil temperature (2) Cooler temperature (2)

Engine oil level (2) Engine coolant level (2)

Engine coolant pressure (2)

Turbo pressure (2)
Fuel Consumption (2)
Tank autonomy - hrs (5)

Fuel remaining quatity (5) Fuel used quantity (5)

ALTERNATOR MEASURES

Generator Voltage L1, L2, L3 Generator Voltage L1-N, L2-N, L3-N Generator frequency Generator current L1, L2, L3 Generator Apparent Power kVA Generator Active Power kW Generator Reactive Power kVAR Generator accumulated power kWh

Power factor Cosfi MAINS MEASURES

Mains voltage L1, L2, L3 Mains voltage L1-N, L2-N, L3-N Mains frequency

COMMUNICATION PORTS

Can-bus port

RS485 port with Mod-bus RTU communication RS232 port for display connection

USB port for parameters saving and firmware update

EQUIPMENT

Microprocessor Logic Back-lit display

Programmable from display

16 event log

Multiple display languages

STOP button START button TEST button Reset alarm button Alarm mute button

Fuel transfer pump activation button

Glow-plug activation button

PRE-ALARMS/ ALARMS

Common Alarm Fuel reserve (pre-alarm) Low fuel level (alarm)

Tank overflow
Charge alternator fa

Charge alternator failed (dinamo) Low oil pressure (pre-alarm) (1) Low oil pressure (alarm)

Oil sensor failed (alarm)

High coolant temperature (pre-alarm) (1) High coolant temperature (alarm)

Low coolant temperature (pre-alarm)

Low water level (1) Water in fuel (1) Battery undervoltage Battery overvoltage GS failure to start GS failure to stop Can-bus Failure

No Can-bus communication Genset overload L1, L2, L3 phases

Genset overload L1, L2, L3
Genset short circuit
Genset overvoltage
Genset undervoltage
Genset high frequency
Genset low frequency
overspeed

overspeed
Reverse power
Earth fault (pre-alarm)
Earth fault (alarm)
Block from password
CAN communication Failed
Maintenance request
Emergency button pressed
Remote emergency active

Forced stop

External battery failed

Fuel theft

Genset negative phase sequence Mains negative phase sequence

Fuel theft protection

VISUALIZATIONS ON CONTROL MODULE/DISPLAY

Pre-alarms

Alarms

Engine measures Alternator measures

Mains measures
Date and time
Operating mode

Genset status Mains status

Mains contactor status Genset contactor status

Digital Input and Output status

Grounding current mA (3) Grounding current threshold mA (3)

Delay time of differential protection (3)

Glow plugs status

CONTROL MODULE FUNCTIONS

Automatic start and stop when the Mains Fails (7)

Remote Start and Stop

Remote Start and Stop with key in OFF position

Manual Start and stop

Emergency stop button on panel board

Remote emergency stop

Remote lock

Remote test without load Remote test on load

Scheduled start-ups

MODBUS commands (Start, Stop, Reset, Test)

CONTROL MODULE SPECIAL FUNCTIONS (on demand)

Automatic charging of an external battery

Dummy load (4) Load shedding (4)

Redundant starter motor management

Fuel monitoring GS battery Load test Idle mode

Service phone number indication Variable speed Generator

Master / Slave mode

viaster / Slave mode

(1) Present with the sensor installed on engine

(2) Present according to the engine equipment and to the ECU type (ECU - Canbus)

(3) Present only with the residual current device mounted on genset board

- (4) Present with optional expansion modules
- (5) Present with special function activated
- (6) Only with the optional of the automatic fuel refilling system on board
- (7) Only in AMF mode



OPTIONAL

Fuel Supply



O.G-ACO-AT-C3V-02 External fuel tank connections with 3-way valve for supply from internal or external tank (130/700 kVA)



O.G-ACO-AT-CI-02 External tank connections for supply only from external tank (g without tank) GE 130/700



O.G-ACO-ST-BG-ES1 "Easy" automatic fuel refilling system on board, controlled by QPE-C and QLE-B panels

O.G-ACO-ST-BG-HDT

"Heavy Duty" automatic fuel refilling system on board, controlled by QPE-C and QLE-B panels



O.G-ACO-ST-BG-STD "Standard" automatic fuel refilling system on board, controlled by QPE-C and QLE-B panels

Electrical on board



O.Q-QLE-K-DIF-M3

Adjustable differential protection only for MC2-PLUS controller for Gen Sets 10/500 kVA (+011 variant)



O.Q-QPE-485.CONV-LAN Converter 485/LAN for QPE-C, QLE-B panel



O.Q-QPE-485.CONV-USB Converter 485/USB for QPE panel

O.Q-QPE-DIS-MS.01	MASTER/SLAVE device for QPE panel
O.Q-QPE-K-DIF	Differential protection adjustable for the MC4
O.Q-QPE-MD-QPE-C	GSM remote management modem for QPE panel



O.Q-QPE-PR-QPE-C Remote panel for QPE-C, QLE-B - available only for variant +10/+11



O.Q-QPE-QBM-COM-AMF25 Option with QBM COMAP AMF25 controller on board instead of QPE



O.Q-QPE-QBM-DSE-7320 Option with QBM DSE7320 controller on board instead of QPE.



O.Q-QPE-RIL-16RELE 16-relay module for QPE panel



O.Q-QPE-RX8-QPE-C Start-stop radio control with max. radius 500 mt indoors and 5 km outdoors (for QPE panel).



O.Q-QPE-SAS-02 Auto Start-Stop at load request (QPE, QLE panels)





	O.Q-QPE-SCD-01	Anti-condensation heater inside the panel
	O.Q-QPE-SEL-50-60	Switch selector 50Hz 400V / 60Hz 480V
	O.Q-QPE-TG-EVO-GPS-4G	Remote management system via LAN/GSM 4G with WEB application and GPS location system
	O.Q-QPE-TG-QPE-C	Remote management software via LAN for QPE-C, QLE-B panel compatible with Windows XP and 7
Caracter Engine		
	O.G-MOT-K-40C-05	Engine liquids suitable for -40°C ambient temperature for Gen Sets 450/700 kVA
	O.G-MOT-PO-02	Oil change pump for Gen Sets 130/700 kVA
#15 bre	O.G-MOT-SC-AC-EL-04	Super hot engine heater 230V with thermostat on board for Gen Sets 275/700 kVA
>	O.G-MOT-SE-LR-02	Radiator coolant level sensor from 130 to 700 kVA
ATS Panels		
2	QC2.0800A	Separate ATS panel, ABB 800A motorized change-over (500 kVA 400V) Dim. 60 x 50 x 160 cm - 128 kg. (ex QC2.550)
C Exhaust		
	O.G-SCA-MR-07	Residential muffler -35 dBA (450/700 kVA)
	O.G-SCA-PF-05	Spark arrestor for Gen Sets 450/700 kVA

PRP


Engines of this rating provide unlimited hours of usage in a variable load application. The average load factor should not exceed 70% of the engine's prime power rating with a maximum number of 500 operational hours at 100% prime power rating. An overload capability of 10% is available, however, is limited to a period of 1 in every 12 hours

LTP


Limited-time running power is defined as the maximum power available, under the agreed operating conditions, for which the generating set is capable of delivering for up to 500h of operation per year with the maintenance intervals. The overload is not allowed.



₩ GE.DW.580/520.ST.BF+011

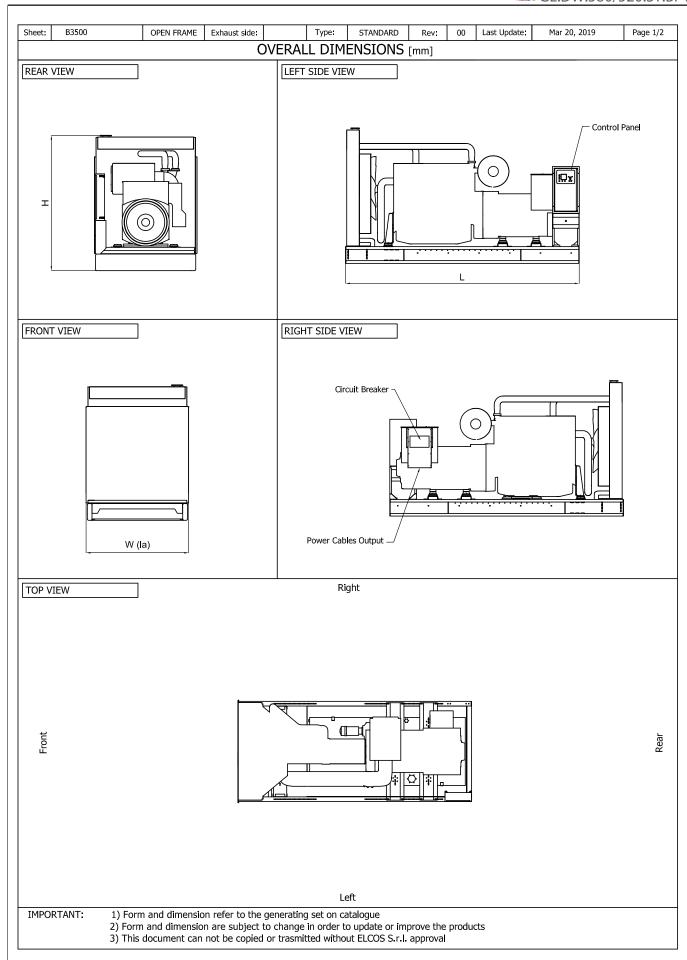



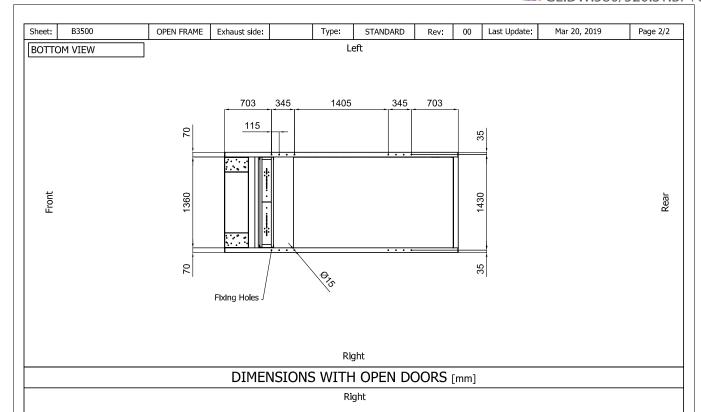

Left

VENTILATION OF THE ROOM

The windows area in the generating set room needs to be (recommended):

Aspiration: on request Expulsion: on request

ATTENTION: for a correct ventilation the expulsion air and the exaust gas needs to be conveyed in the open-air

IMPORTANT:

Front

- 1) Form and dimension refer to the generating set on catalogue
- 2) Form and dimension are subject to change in order to update or improve the products
 3) This document can not be copied or trasmitted without ELCOS S.r.l. approval

Rear